


Constraint	Analysis Details
Saratoga - Petenwell 138-kV Line	Candidate for 2011 Order 890 Analysis
Albers - Kenosha 138-kV Line	Candidate for 2011 Order 890 Analysis

ATC Planning Zones

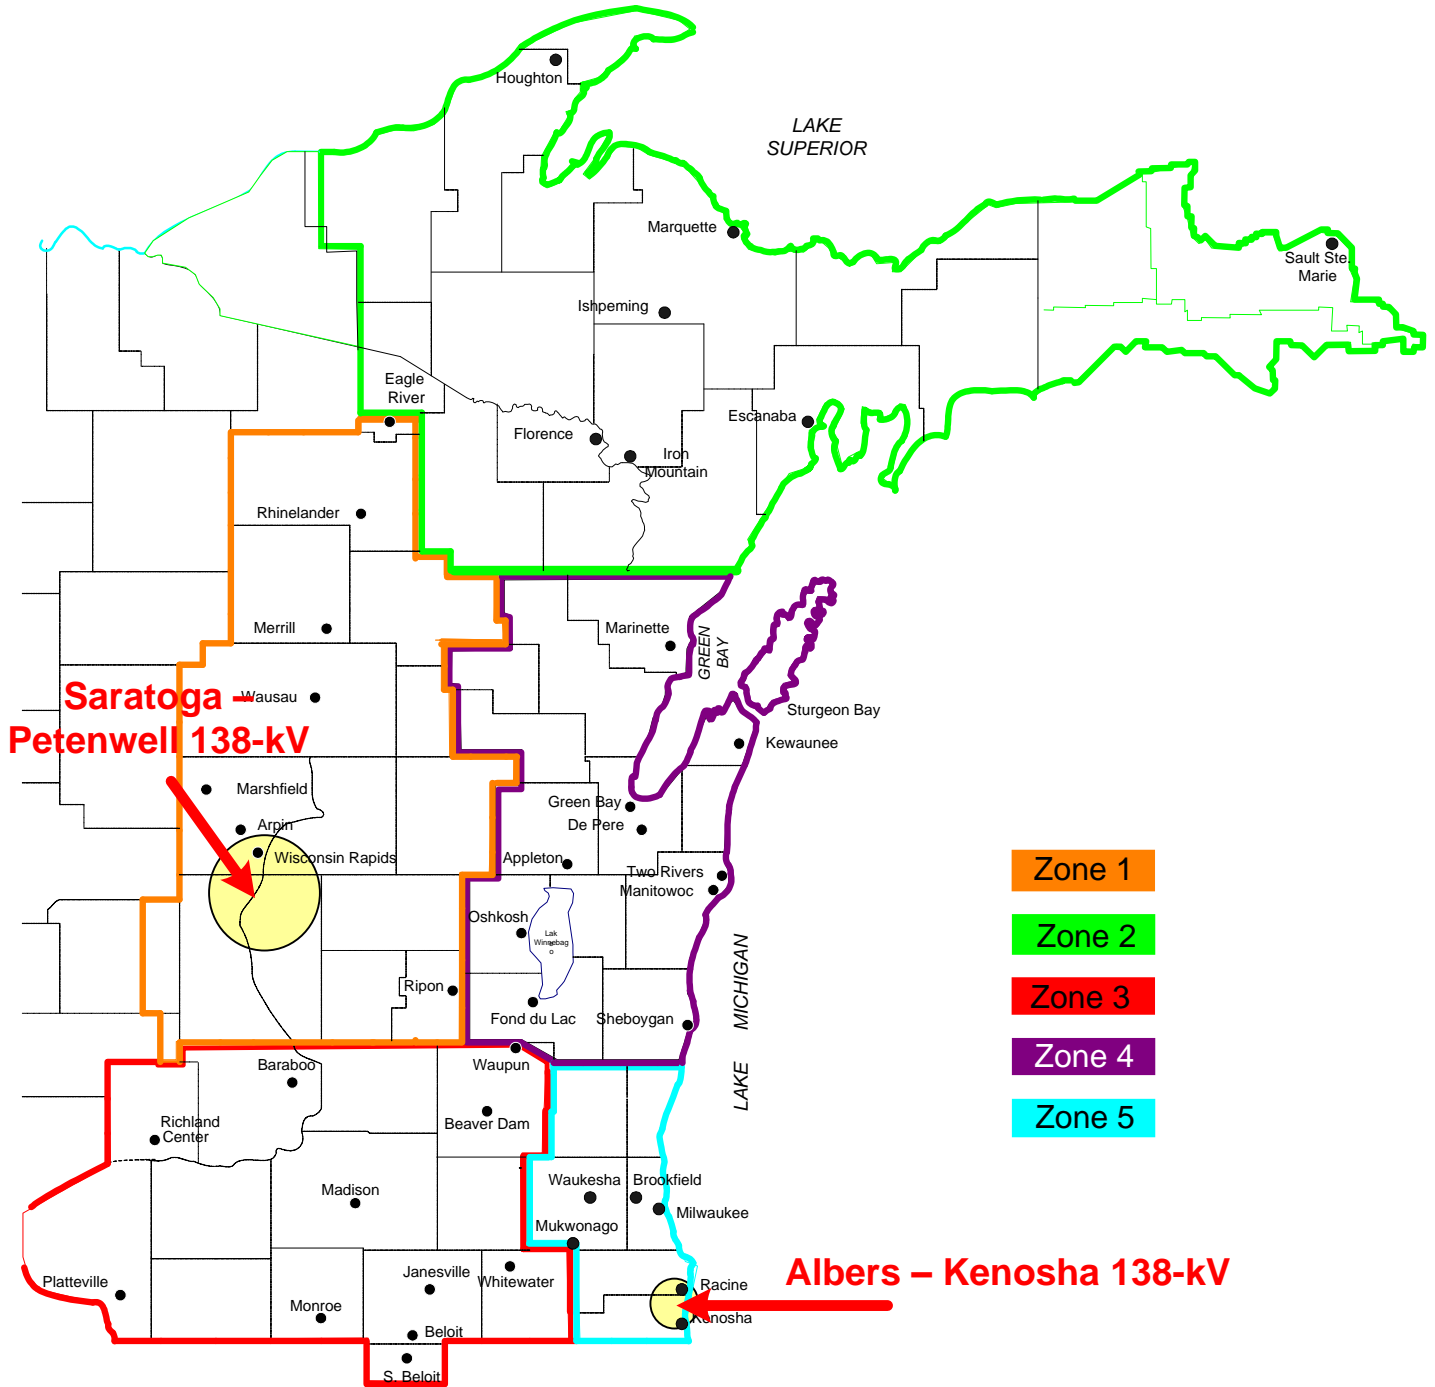

These are preliminary assumptions as of the date of this document. ATC's planning analysis is a continuing process, and ATC will provide updates as appropriate. ATC may also change its planning assumptions or methodology with respect to this study and any such change may alter the results of its analysis.